


Dean of Students
Charmaine Flynn

CSE Chairperson
Mark Robinson

Guidance Counselor
Chris Ford

Athletic Director
Michael Douglas

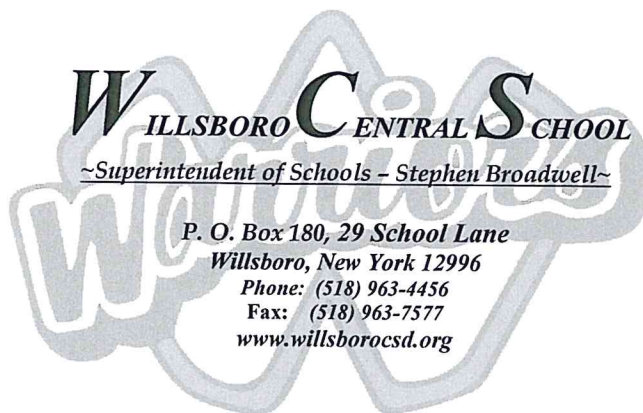

Board of Education
Phyllis Klein, President
Herb Longware, Vice President
Don Hollingsworth
Craig Jackson
Kasey Young

Brandy Pierce, District Clerk
Sheila Vanags, Treasurer

December 1, 2016

Dear Parents and Staff Members:

On September 6, 2016, Governor Andrew Cuomo signed legislation requiring all school districts in New York State to test potable water systems for lead contamination and to take responsive actions. This law, and subsequent NYS Department of Health Regulations, requires samples to be drawn from schools on or before September 30th. Here at Willsboro Central School, we collected samples on September 27th, 2016. Samples are required to be “first draw” samples, which requires that the water remain motionless for at least eight (8) hours in the pipes and outlets (faucets, drinking fountains, etc.) before it is sampled.

The level of lead concentration at a water outlet that requires us to take action is above fifteen (15) parts per billion (.015 mg/L). Test results that were received by the district on December 1st for the 138 outlets tested showed that 12 of the outlets in the district were above action level. The locations the concentration levels, and our immediate action plan for the outlets is listed on the reverse side. **None** of the samples that required action were from drinking fountains. We will work with Department of Health officials to insure that retesting protocols, and clearance testing of the newly installed replacement outlets, are completed as required.

Please be assured that the health and wellness of our students and staff is our top priority, and that we will take all steps necessary to ensure that the water in our buildings is safe to drink.

In addition to this notification, test results for all outlets will be posted on our website www.willsborocsd.org, in the near future.

Sincerely,

Stephen Broadwell
Superintendent of Schools

Lead Testing Results for Willsboro Central School

Location	Concentration (mg/L)	Action
H106 HS Science Lab Faucet	0.0695	Lab Sink has been labeled "Not potable water - Do not use for drinking or cooking"
H106 HS Science Lab Faucet	0.0261	Lab Sink has been labeled "Not potable water - Do not use for drinking or cooking"
H106 HS Science Lab Faucet	0.0192	Lab Sink has been labeled "Not potable water - Do not use for drinking or cooking"
Boys Locker Room Sink	0.0267	Sink has been labeled "Not potable water - Do not use for drinking or cooking"
Girls Locker Room Sink	0.1000	Sink has been labeled "Not potable water - Do not use for drinking or cooking"
Boys Coaches Office Sink	0.0832	Sink has been labeled "Not potable water - Do not use for drinking or cooking"
E117 Recess Room Sink	0.2400	Sink has been labeled "Not potable water - Do not use for drinking or cooking"
Concession Stand Sink	0.0160	Sink has been labeled "Not potable water - Do not use for drinking or cooking"
Concession Stand Sink	0.0458	Sink has been labeled "Not potable water - Do not use for drinking or cooking"
Concession Stand Bathroom Sin	0.2000	Sink has been labeled "Not potable water - Do not use for drinking or cooking"
Consession Stand Bathroom Sin	0.0410	Sink has been labeled "Not potable water - Do not use for drinking or cooking"
Consession Stand Outside Faucet	0.1100	Faucet has been lable "Not potable water - Do not use for drinking or cooking"